

**GENERAL SOIL EROSION AND SEDIMENT CONTROL NOTES**

1. ALL APPLICABLE EROSION AND SEDIMENT CONTROL PRACTICES SHALL BE IN PLACE PRIOR TO ANY GRADING OPERATION AND/OR INSTALLATION OF PROPOSED STRUCTURES OR UTILITIES.
2. SOIL EROSION AND SEDIMENT CONTROL PRACTICES ON THIS PLAN SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE STANDARDS FOR SOIL EROSION AND SEDIMENT CONTROL IN NEW JERSEY.
3. APPLICABLE EROSION AND SEDIMENT CONTROL PRACTICES SHALL BE LEFT IN PLACE UNTIL CONSTRUCTION IS COMPLETED AND/OR THE AREA IS STABILIZED.
4. THE CONTRACTOR SHALL PERFORM ALL WORK, FURNISH ALL MATERIALS AND INSTALL ALL MEASURES REQUIRED TO REASONABLY CONTROL SOIL EROSION RESULTING FROM CONSTRUCTION OPERATIONS AND PREVENT EXCESSIVE FLOW OF SEDIMENT FROM THE CONSTRUCTION SITE.
5. ANY DISTURBED AREA THAT IS TO BE LEFT EXPOSED FOR MORE THAN THIRTY (30) DAYS AND NOT SUBJECT TO CONSTRUCTION TRAFFIC SHALL IMMEDIATELY RECEIVE A TEMPORARY SEEDING AND FERTILIZATION IN ACCORDANCE WITH THE NEW JERSEY STANDARDS AND THEIR RATES SHOULD BE INCLUDED IN THE NARRATIVE. IF THE SEASON PROHIBITS TEMPORARY SEEDING, THE DISTURBED AREAS WILL BE MULCHED WITH SALT HAY OR EQUIVALENT AND ANCHORED IN ACCORDANCE WITH THE NEW JERSEY STANDARDS (I.E. PEG AND TWINE, MULCH NETTING OR LIQUID MULCH BINDER).
6. IT SHALL BE THE RESPONSIBILITY OF THE DEVELOPER TO PROVIDE CONFIRMATION OF LIME, FERTILIZER AND SEED APPLICATION AND RATES OF APPLICATION AT THE REQUEST OF THE CAPE ATLANTIC SOIL CONSERVATION DISTRICT.
7. ALL CRITICAL AREAS SUBJECT TO EROSION WILL RECEIVE A TEMPORARY SEEDING IN COMBINATION WITH STRAW MULCH AT A RATE OF 2 TONS PER ACRE, ACCORDING TO THE NEW JERSEY STANDARDS IMMEDIATELY FOLLOWING ROUGH GRADING.
8. THE SITE SHALL AT ALL TIMES BE GRADED AND MAINTAINED SUCH THAT ALL STORMWATER RUNOFF IS DIVERTED TO SOIL EROSION AND SEDIMENT CONTROL FACILITIES.
9. ALL SEDIMENTATION STRUCTURES WILL BE INSPECTED AND MAINTAINED ON A REGULAR BASIS AND AFTER EVERY STORM EVENT.
10. A CRUSHED STONE, TIRE CLEANING PAD WILL BE INSTALLED WHEREVER A CONSTRUCTION ACCESS EXISTS. THE STABILIZED PAD WILL BE INSTALLED ACCORDING TO THE STANDARD FOR STABILIZED CONSTRUCTION ACCESS.
11. ALL DRIVEWAYS MUST BE STABILIZED WITH 2 1/2" CRUSHED STONE OR SUBBASE PRIOR TO INDIVIDUAL LOT CONSTRUCTION.
12. PAVED ROADWAYS MUST BE KEPT CLEAN AT ALL TIMES.
13. ALL CATCH BASIN INLETS WILL BE PROTECTED ACCORDING TO THE CERTIFIED PLAN.
14. ALL STORM DRAINAGE OUTLETS WILL BE STABILIZED, AS REQUIRED, BEFORE THE DISCHARGE POINTS BECOME OPERATIONAL.
15. ALL DEWATERING OPERATIONS MUST DISCHARGE DIRECTLY INTO A SEDIMENT FILTER AREA. THE SEDIMENT FILTER SHOULD BE COMPOSED OF A SUITABLE SEDIMENT FILTER FABRIC. (SEE DETAIL) THE BASIN MUST BE DEWATERED TO NORMAL POOL WITHIN 10 DAYS OF THE DESIGN STORM.
16. N.J.S.A. 4:24-39, ET SEQ. REQUIRES THAT NO CERTIFICATE OF OCCUPANCY BE ISSUED BEFORE ALL PROVISIONS OF THE CERTIFIED SOIL EROSION AND SEDIMENT CONTROL PLAN HAVE BEEN COMPLIED WITH FOR PERMANENT MEASURES. ALL SITE WORK FOR THE PROJECT MUST BE COMPLETED PRIOR TO THE DISTRICT ISSUING A REPORT OF COMPLIANCE AS A PREREQUISITE TO THE ISSUANCE OF A CERTIFICATE OF OCCUPANCY BY THE MUNICIPALITY.
17. MULCHING IS REQUIRED ON ALL SEEDED AREAS TO INSURE AGAINST EROSION BEFORE GRASS IS ESTABLISHED TO PROMOTE EARLIER VEGETATION COVER.
18. OFFSITE SEDIMENT DISTURBANCE MAY REQUIRE ADDITIONAL CONTROL MEASURES TO BE DETERMINED BY THE EROSION CONTROL INSPECTOR.
19. A COPY OF THE CERTIFIED SOIL EROSION AND SEDIMENT CONTROL PLAN MUST BE MAINTAINED ON THE PROJECT SITE DURING CONSTRUCTION.
20. THE CAPE ATLANTIC SOIL CONSERVATION DISTRICT SHALL BE NOTIFIED 48 HOURS PRIOR TO ANY LAND DISTURBANCE.
21. ANY CONVEYANCE OF THIS PROJECT PRIOR TO ITS COMPLETION WILL TRANSFER FULL RESPONSIBILITY FOR COMPLIANCE WITH THE CERTIFIED PLAN TO ANY SUBSEQUENT OWNERS.
22. IMMEDIATELY AFTER THE COMPLETION OF STRIPPING AND STOCKPILING OF TOPSOIL, THE STOCKPILE MUST BE STABILIZED ACCORDING TO THE STANDARD FOR TEMPORARY VEGETATIVE COVER, STABILIZE TOPSOIL PILE WITH STRAW MULCH FOR PROTECTION IF THE SEASON DOES NOT PERMIT THE APPLICATION AND ESTABLISHMENT OF TEMPORARY SEEDING. ALL SOIL STOCKPILES ARE NOT TO BE LOCATED WITHIN FIFTY (50) FEET OF A FLOODPLAIN, SLOPE, ROADWAY OR DRAINAGE FACILITY AND THE BASE MUST BE PROTECTED WITH A SEDIMENT BARRIER.
23. ANY CHANGES TO THE SITE PLAN WILL REQUIRE THE SUBMISSION OF A REVISED SOIL EROSION AND SEDIMENT CONTROL PLAN TO THE CAPE ATLANTIC SOIL CONSERVATION DISTRICT. THE REVISED PLAN MUST BE IN ACCORDANCE WITH THE CURRENT NEW JERSEY STANDARDS FOR SOIL EROSION AND SEDIMENT CONTROL.
24. METHODS FOR THE MANAGEMENT OF HIGH ACID PRODUCING SOILS SHALL BE IN ACCORDANCE WITH THE STANDARDS. HIGH ACID PRODUCING SOILS ARE THOSE FOUND TO CONTAIN IRON SULFIDES OR HAVE A PH OF 4 OR LESS.
25. TEMPORARY AND PERMANENT SEEDING MEASURES MUST BE APPLIED ACCORDING TO THE NEW JERSEY STANDARDS, AND MULCHED WITH SALT HAY OR EQUIVALENT AND ANCHORED IN ACCORDANCE WITH THE NEW JERSEY STANDARDS (I.E. PEG AND TWINE, MULCH NETTING OR LIQUID MULCH BINDER).
26. MAXIMUM SIDE SLOPES OF ALL EXPOSED SURFACES SHALL NOT BE CONSTRUCTED STEEPER THAN 3:1 UNLESS OTHERWISE APPROVED BY THE DISTRICT.
27. DUST IS TO BE CONTROLLED BY AN APPROVED METHOD ACCORDING TO THE NEW JERSEY STANDARDS AND MAY INCLUDE WATERING WITH A SOLUTION OF CALCIUM CHLORIDE AND WATER.
28. ADJOINING PROPERTIES SHALL BE PROTECTED FROM EXCAVATION AND FILLING OPERATIONS ON THE PROPOSED SITE.
29. USE STAGED CONSTRUCTION METHODS TO MINIMIZE EXPOSED SURFACES, WHERE APPLICABLE.
30. ALL VEGETATIVE MATERIAL SHALL BE SELECTED IN ACCORDANCE WITH AMERICAN STANDARDS FOR NURSERY STOCK OF THE AMERICAN ASSOCIATION OF THE NURSERYMEN AND IN ACCORDANCE WITH THE NEW JERSEY STANDARDS.
31. NATURAL VEGETATION AND SPECIES SHALL BE RETAINED WHERE SPECIFIED ON THE LANDSCAPE PLAN.
32. THE SOIL EROSION INSPECTOR MAY REQUIRE ADDITIONAL SOIL EROSION MEASURES TO BE INSTALLED, AS DIRECTED BY THE DISTRICT INSPECTOR.
33. A REPORT OF COMPLIANCE MUST BE OBTAINED FROM THE DISTRICT PRIOR TO RECEIVING A CERTIFICATE OF OCCUPANCY FROM THE MUNICIPALITY. A REQUEST FOR A DISTRICT INSPECTION FOR THE RELEASE OF A REPORT OF COMPLIANCE MUST BE MADE 5 WORKING DAYS IN ADVANCE. THIS APPLIES TO BOTH COMPLETE (FINAL) AND CONDITIONAL (TEMPORARY) CERTIFICATES. ALL STREETS AND UNITS MUST BE PROPERLY IDENTIFIED. A REPORT OF COMPLIANCE WILL NOT BE RELEASED FOR A UNIT IF IT CAN NOT BE IDENTIFIED. IDENTIFY ALL UNITS AT THE SITE BY BLOCK, LOT, AND STREET ADDRESS.
34. REMOVE ANY SEDIMENT THAT MAY BE SPILLED, DROPPED, OR TRACKED OFF THE PROJECT SITE. ALL PAVED RIGHT-OF-WAYS ADJACENT TO THE PROJECT SITE MUST BE MAINTAINED IN A CLEAN, SWEEP CONDITION THROUGHOUT CONSTRUCTION. INSTALL CRUSHED STONE PAD(S) TO HELP REDUCE OFF-SITE TRACKING OF SEDIMENT.
35. THE PROPERTY OWNER SHALL BE RESPONSIBLE FOR ANY EROSION OR SEDIMENTATION THAT MAY OCCUR BELOW STORMWATER OUTFALLS OR OFFSITE AS A RESULT OF CONSTRUCTION OF THE PROJECT.

**CONSTRUCTION SEQUENCE**

	WEEK TO WEEK
1. CONTACT THE CAPE ATLANTIC SOIL CONSERVATION DISTRICT AT (609) 625-3144 A MINIMUM OF 72 HOURS PRIOR TO ANY SOIL DISTURBANCE TO ARRANGE A PRECONSTRUCTION MEETING.	0 1
2. THE ORIGINAL CAPE ATLANTIC SOIL CONSERVATION DISTRICT CERTIFICATION AND PLANS WILL BE AVAILABLE AT THE SITE AT ALL TIMES.	0 1
3. INSTALL SOIL EROSION AND SEDIMENT CONTROL MEASURES (e.g. SEDIMENT FENCE, CONSTRUCTION ENTRANCE, STAGING AREA). DISTURB ONLY THE MINIMUM AREA NEEDED TO INSTALL ALL MEASURES.	0 1
4. DEMOLISH EXISTING SIDEWALK AND UTILITIES (AS NOTED) TO LIMITS SHOWN ON PLAN.	1 2
5. STRIP AND STOCKPILE TOPSOIL. ROUGH GRADE SITE.	2 3
6. INSTALL UNDERGROUND UTILITIES.	3 4
7. CONSTRUCT BUILDING FOUNDATION AND SUPERSTRUCTURE.	4 16
8. CONSTRUCT CURB, SIDEWALK, SYNTHETIC TURF, AND DECOMPOSED GRANITE SURFACES.	4 16
9. APPLY LANDSCAPING, RESEED AND MULCH ALL DISTURBED AREAS. REMOVE ALL SOIL EROSION AND SEDIMENT CONTROL MEASURES.	8 9
10. CONTACT CAPE ATLANTIC SOIL CONSERVATION DISTRICT FOR FINAL INSPECTION.	9 16
NOTE: SEQUENCE OF CONSTRUCTION IS APPROXIMATE AND IS SUBJECT TO WEATHER CONDITIONS, LABOR AND MATERIAL AVAILABILITY.	16

**SEEDING AND MULCHING SPECIFICATIONS**

**TEMPORARY STABILIZATION WITH MULCH ONLY**

1. UNROTTED SMALL-GRAIN STRAW, AT 2.0 TO 2.5 TONS PER ACRE, IS SPREAD UNIFORMLY AT 90 TO 115 LBS. PER 1,000 SQUARE FEET.
2. OTHER SUITABLE MATERIAL MAY BE USED IF APPROVED BY THE DISTRICT.
3. THIS PRACTICE IS APPLICABLE TO AREAS SUBJECT TO EROSION, WHERE THE SEASON AND OTHER CONDITIONS MAY NOT BE SUITABLE FOR GROWING AN EROSION-RESISTANT COVER OR WHERE STABILIZATION IS NEEDED FOR A SHORT PERIOD UNTIL MORE SUITABLE ANCHORING CAN BE APPLIED.
4. MULCH ANCHORING SHOULD BE ACCOMPLISHED IMMEDIATELY AFTER PLACEMENT OF HAY OR STRAW MULCH TO MINIMIZE LOSS BY WIND OR WATER. ANCHORING SHALL BE COMPLETED BY ONE OF THE FOLLOWING:
  - 4.1. PEG AND TWINE - DRIVE 8 TO 10 INCH WOODEN PEGS TO WITHIN 2 TO 3 INCHES OF THE SOIL SURFACE EVERY 4 FEET IN ALL DIRECTIONS. STAKES MAY BE DRIVEN BEFORE OR AFTER APPLYING MULCH. SECURE MULCH TO SOIL SURFACE BY STRETCHING TWINE BETWEEN PEGS IN A CRISS-CROSS AND SQUARE PATTERN. SECURE TWINE AROUND EACH PEG WITH TWO OR MORE ROUND TURNS.
  - 4.2. MULCH NETTINGS - STAPLE PAPER, COTTON, OR PLASTIC NETTING OVER MULCH. USE DEGRADABLE NETTING IN AREAS TO BE MOWED. NETTING IS USUALLY AVAILABLE IN ROLLS 4 FEET WIDE AND UP TO 300 FEET LONG.

**TEMPORARY SEEDING**

1. SITE PREPARATION
  - A. GRADE AS NEEDED AND FEASIBLE TO PERMIT THE USE OF CONVENTIONAL EQUIPMENT FOR SEEDBED PREPARATION, SEEDING, MULCH APPLICATION, AND MULCH ANCHORING. ALL GRADING SHOULD BE DONE IN ACCORDANCE WITH STANDARD FOR LAND GRADING, SECTION 19 OF THE STANDARDS FOR SOIL EROSION AND SEDIMENT CONTROL IN NEW JERSEY.
  - B. INSTALL NEEDED EROSION CONTROL PRACTICES OR FACILITIES.
  - C. IMMEDIATELY PRIOR TO SEEDING, THE SURFACE SHOULD BE SCARIFIED 6" TO 12" WHERE THERE HAS BEEN SOIL COMPACTION. THIS PRACTICE IS PERMISSIBLE ONLY WHERE THERE IS NO DANGER TO UNDERGROUND UTILITIES.
2. SEEDBED PREPARATION
  - A. APPLY GROUND LIMESTONE AND FERTILIZER PER RUTGERS CO-OPERATIVE EXTENSION RECOMMENDATIONS. FERTILIZER SHALL BE APPLIED AT THE RATE OF 500 LBS./AC. (11 LBS./1,000 SQ.FT.) OF 10-20-10 OR EQUIVALENT WITH 50% WATER INSOLUBLE NITROGEN. APPLY LIMESTONE AT THE RATE OF 2 TONS/ACRE UNLESS SOIL TESTING INDICATES OTHERWISE. INCORPORATE INTO THE SURFACE 4 INCHES WITH A DISC, SPRING-TOOTH HARROW, OR OTHER SUITABLE EQUIPMENT.
  - B. SEEDING (COOL SEASON)
    - A. SEED MIX: PERENNIAL RYEGRASS
    - B. SEEDING RATE: 100 LBS./AC. (1.0 LBS./1,000 SQ.FT.)
    - C. OPTIMUM SEEDING DATES: 02/15 THRU 05/01
    - D. OPTIMUM SEED DEPTH: 0.5 INCHES
  - C. SEEDING (WARM SEASON)
    - A. SEED MIX: PEARL MILLET
    - B. SEEDING RATE: 20 LBS./AC. (0.5 LBS./1,000 SQ.FT.)
    - C. SEEDING DATES: 05/01 THRU 09/01
    - D. OPTIMUM SEED DEPTH: 1.0 INCHES
3. SEEDING (COOL SEASON)
  - A. SEED MIX: PERENNIAL RYEGRASS
  - B. SEEDING RATE: 100 LBS./AC. (1.0 LBS./1,000 SQ.FT.)
  - C. OPTIMUM SEEDING DATES: 02/15 THRU 05/01
  - D. OPTIMUM SEED DEPTH: 0.5 INCHES
4. SEEDING (WARM SEASON)
  - A. SEED MIX: PEARL MILLET
  - B. SEEDING RATE: 20 LBS./AC. (0.5 LBS./1,000 SQ.FT.)
  - C. SEEDING DATES: 05/01 THRU 09/01
  - D. OPTIMUM SEED DEPTH: 1.0 INCHES
5. MULCHING: STRAW OR HAY IS REQUIRED ON ALL SEEDING. MULCHING RATE: 1-1/2 TO 2 TONS/AC. (70-90 LBS./1,000 SQ.FT.) ANCHORING: PEG AND TWINE OR MULCH NETTING

**PERMANENT SEEDING**

1. ALL AREAS TO BE GRASSED WILL BE SYNTHETIC TURF AS PER THE LANDSCAPE AND LIGHTING PLAN AND DETAILS.

**DUST CONTROL**

**DEFINITION**  
THE CONTROL OF DUST ON CONSTRUCTION SITES AND ROADS.

**PURPOSE**  
TO PREVENT BLOWING AND MOVEMENT OF DUST FROM EXPOSED SOIL SURFACES, REDUCED ON-SITE AND OFF-SITE DAMAGE, HEALTH HAZARDS, AND IMPROVE TRAFFIC SAFETY.

**CONDITION WHERE PRACTICE APPLIES**  
THIS PRACTICE IS APPLICABLE TO AREA SUBJECT TO DUST BLOWING AND MOVEMENT WHERE ON-SITE AND OFF-SITE DAMAGE IS LIKELY WITHOUT TREATMENT. CONSULT WITH LOCAL MUNICIPAL ORDINANCES ON ANY RESTRICTIONS.

**WATER QUALITY ENHANCEMENT**  
SEDIMENT DEPOSITED AS "DUST" ARE OFTEN FINE COLLOIDAL MATERIAL WHICH IS EXTREMELY DIFFICULT TO REMOVE FROM WATER ONCE IT BECOMES SUSPENDED. USE OF THIS STANDARD WILL HELP TO CONTROL THE GENERATION OF DUST FROM CONSTRUCTION SITES AND SUBSEQUENT BLOWING AND DEPOSITION INTO LOCAL SURFACE WATER RESOURCES.

**PLANNING CRITERIA**  
THE FOLLOWING METHODS SHOULD BE CONSIDERED FOR CONTROLLING DUST:

**MULCHES** SEE STANDARD OF STABILIZATION WITH MULCHES ONLY, PG. 5-1.

**VEGETATIVE COVER** SEE STANDARD FOR: TEMPORARY VEGETATIVE COVER, PG. 7-1, PERMANENT VEGETATIVE COVER FOR SOIL STABILIZATION, PG. 4-1, AND PERMANENT STABILIZATION WITH SOD, PG. 6-1.

**SPRAY-ON ADHESIVES** ON MINERAL SOILS (NOT EFFECTIVE ON MUCK SOILS). KEEP TRAFFIC OFF THESE AREAS.

**TILLAGE** TO ROUGHEN SURFACE SAND AND BRING CLODS TO THE SURFACE. THIS IS A TEMPORARY EMERGENCY MEASURE WHICH SHOULD BE USED BEFORE SOIL BLOWING STARTS. BEGIN PLOWING ON WINDWARD SIDE OF SITE. CHISEL-TYPE PLOWS SPACED ABOUT 12' APART, AND SPRING TOOTHED HARROWS ARE EXAMPLES OF EQUIPMENT WHICH MAY PRODUCE THE DESIRED EFFECT.

**SPRINKLING** SITE IS SPRINKLED UNTIL THE SURFACE IS WET.


**BARRIERS** SOLID BOARD FENCES, SNOW FENCES, BURLAP FENCES, CRATE WALLS, BALES OF HAY, AND SIMILAR MATERIAL CAN BE USED TO CONTROL AIR CURRENTS AND SOIL BLOWING.

**CALCIUM CHLORIDE** SHALL BE IN THE FORM OF LOOSE, DRY GRANULES OR FLAKES FINE ENOUGH TO FEED THROUGH COMMONLY USED SPREADERS AT A RATE THAT WILL KEEP SURFACE MOIST BUT NOT CAUSE POLLUTION OR PLANT DAMAGE. IF USED ON STEEPER SLOPES, THEN USE OTHER PRACTICES TO PREVENT WASHING INTO STREAMS, OR ACCUMULATION AROUND PLANTS.


**STONE** COVER SURFACE WITH CRUSHED STONE OR COARSE GRAVEL.

TABLE 16-1: DUST CONTROL MATERIALS

MATERIAL	WATER DILUTION	TYPE OF NOZZLE	APPLY GALLONS/ACRE
ANIONIC ASPHALT EMULSION	7:1	COARSE SPRAY	1200
LATEX EMULSION	12.5:1	FINE SPRAY	235
RESIN IN WATER	4:1	FINE SPRAY	300
POLYARYLAMIDE (PAM) SPRAY ON	APPLY ACCORDING TO MANUFACTURER'S INSTRUCTIONS. MAY ALSO BE USED AS AN ADDITIVE TO SEDIMENT BASINS TO FLOCCULATE AND PRECIPITATE SUSPENDED COLLOIDS. SEE SEDIMENT BASIN STANDARD, PG. 26-1.		
POLYARYLAMIDE (PAM) DRY SPREAD			
ACIDULATED SOY BEAN SOAP STICK	NONE	COARSE SPRAY	1200

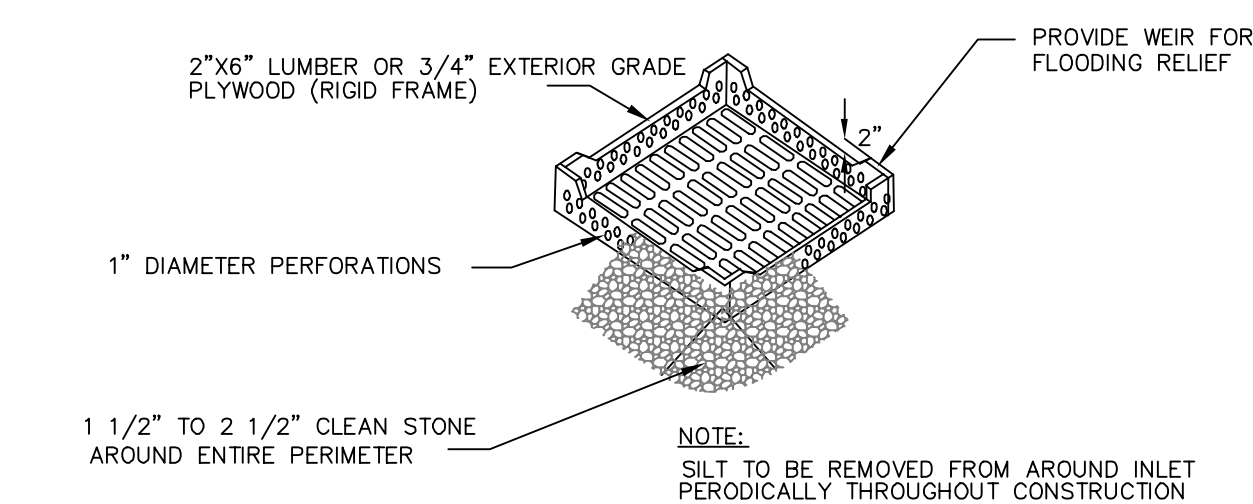

**TYPE "A" & "E" INLET FILTER DETAIL**  
NOT TO SCALE

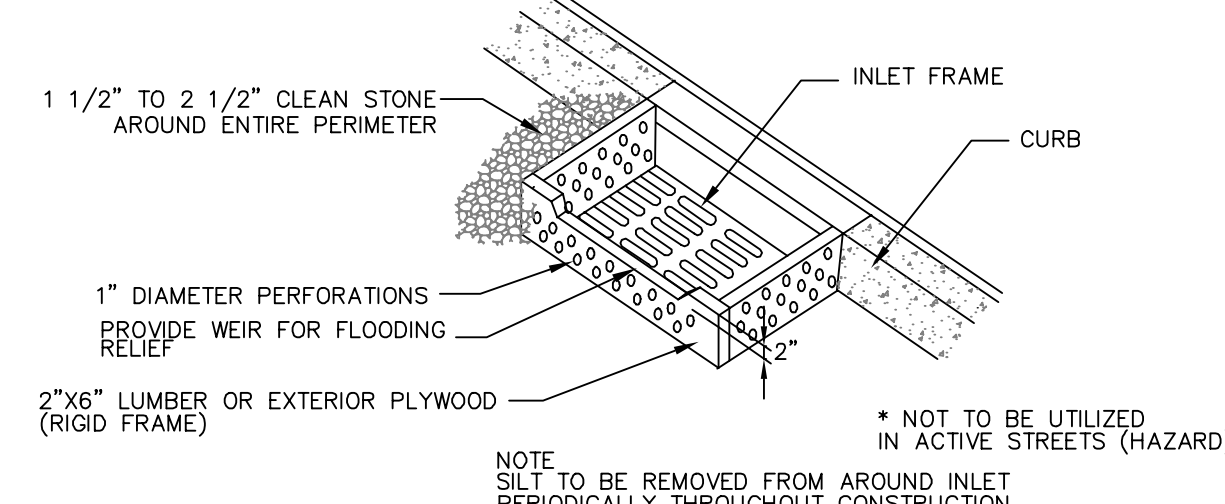

**TYPE "B" INLET FILTER DETAIL**  
NOT TO SCALE


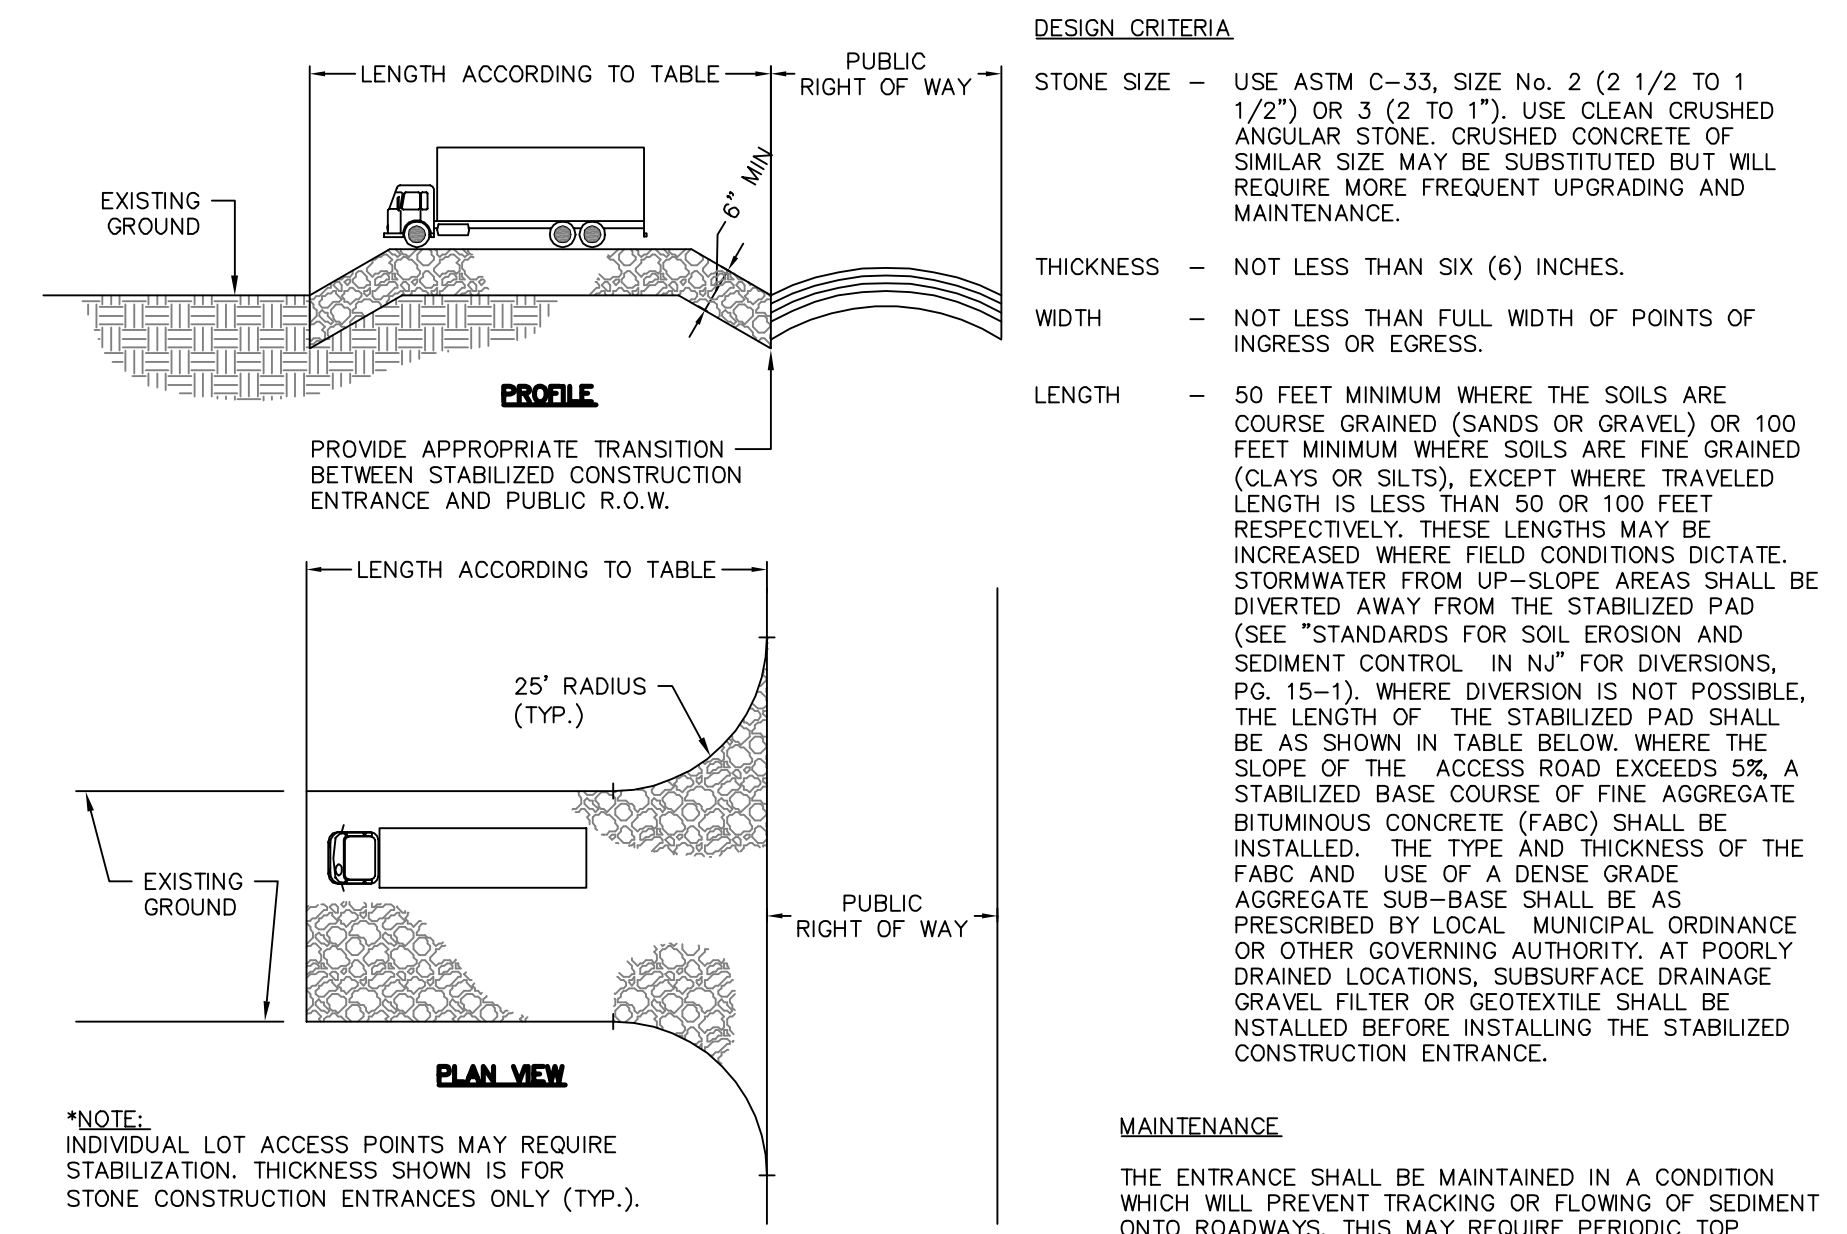


TABLE OF LENGTHS OF CONSTRUCTION EXITS ON SLOPING ROADBEDS


PERCENT SLOPE OF ROADWAY	LENGTH OF STONE REQUIRED	
	COARSE GRAINED SOILS	FINE GRAINED SOILS
0 TO 2%	50 ft.	100 ft.
2 TO 5%	100 ft.	200 ft.
> 5%	ENTIRE SURFACE STABILIZED WITH FABRIC BASE COURSE (NOTE 1)	

1. AS PRESCRIBED BY LOCAL ORDINANCE OR OTHER GOVERNING AUTHORITY


**STABILIZED CONSTRUCTION ACCESS**  
NOT TO SCALE

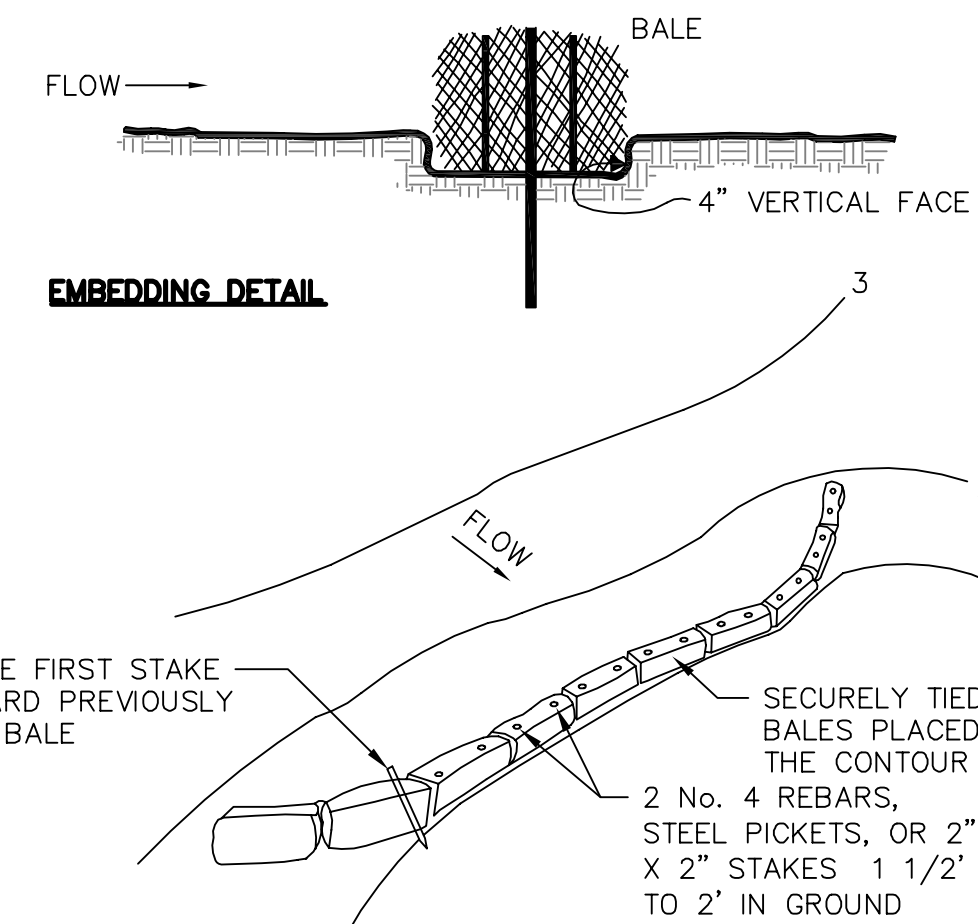

**PLACEMENT AND ANCHORING DETAIL: HAYBALE SEDIMENT BARRIERS**  
NOT TO SCALE

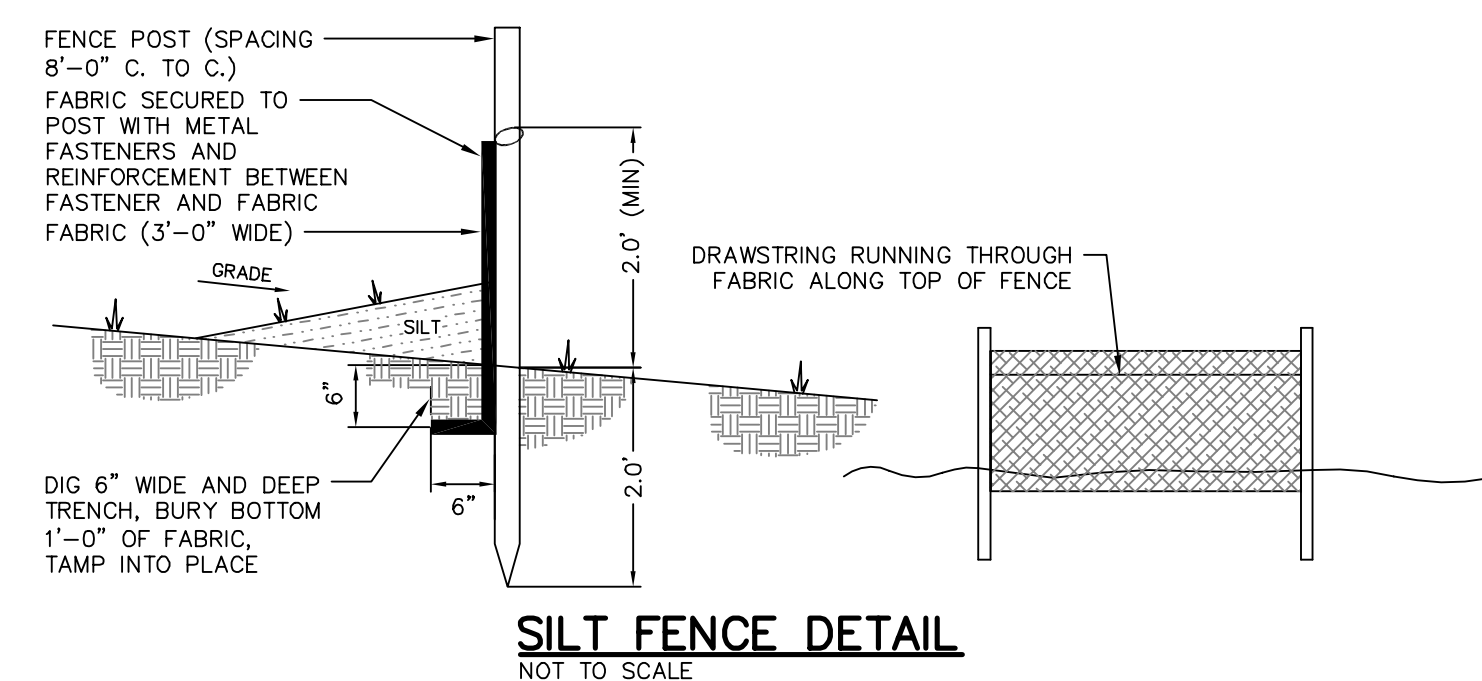

**SILTS FENCE DETAIL**  
NOT TO SCALE

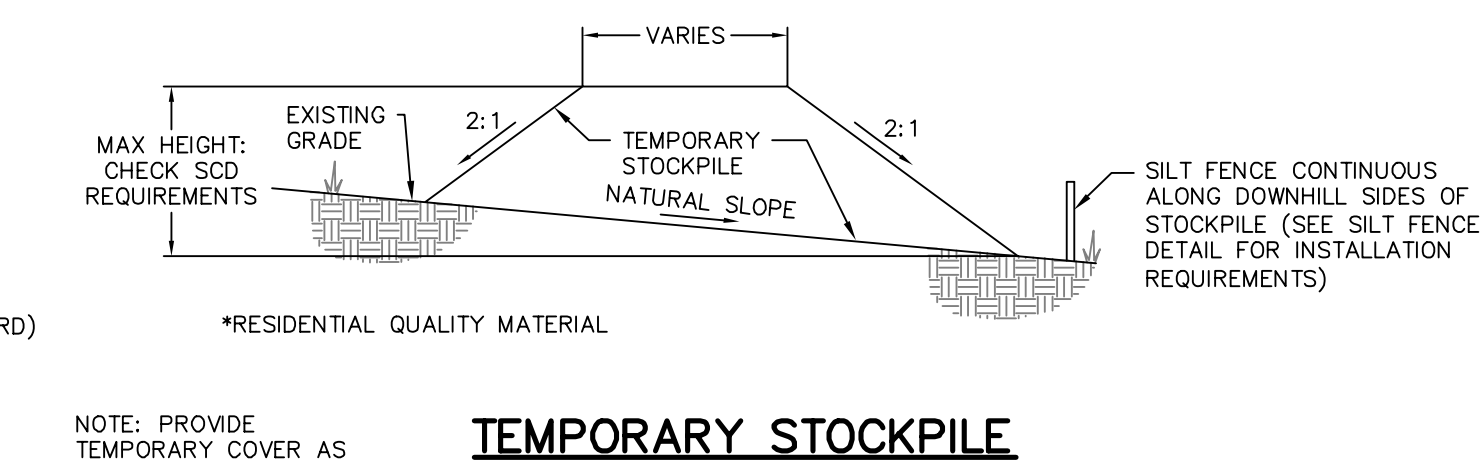

**TEMPORARY STOCKPILE**  
NOT TO SCALE

REV. / ISSUE	DATE	DESCRIPTION

CONSULTANT

ORIENTATION / KEY PLAN

PAULIUS, SOKOLOWSKI AND SARTOR, LLC  
 1909 ROUTE 70 EAST  
 SUITE 307  
 CHERRY HILL, NJ 08003  
 PHONE: (856) 335-6000

CERTIFICATE OF AUTHORIZATION NO. 24GA28032700  
 ALL DIMENSIONS MUST BE VERIFIED BY THE CONTRACTOR. NOTIFY PAULIUS, SOKOLOWSKI AND SARTOR, LLC OF ANY CONFLICTS, ERRORS, AMBIGUITIES OR DISCREPANCIES IN THE CONTRACT DRAWINGS OR SPECIFICATIONS BEFORE PROCEEDING WITH CONSTRUCTION. ALL DIMENSIONS SHALL BE AS NOTED IN METERS OR NUMBERS ON THE CONTRACT DRAWINGS. DO NOT SCALE THE DRAWINGS TO DETERMINE DIMENSIONS. THESE CONTRACT DRAWINGS CONTAIN DATA INTENDED SPECIFICALLY FOR THE NOTED PROJECT AND CLIENT. THEY ARE NOT INTENDED FOR USE ON EXTENSIONS OF THIS PROJECT OR FOR REUSE ON ANY OTHER PROJECT. THE COPYING AND/OR MODIFICATION OF THIS DOCUMENT OR ANY PORTION THEREOF WITHOUT THE WRITTEN PERMISSION OF PAULIUS, SOKOLOWSKI AND SARTOR, LLC IS PROHIBITED. THESE DRAWINGS ARE GRAPHICALLY REPRESENTED AS "CONSTRUCTION SITES". THESE DRAWINGS SHALL NOT BE USED FOR CONSTRUCTION OR IMPROVEMENTS EXCEPT AS NOTED. CONTRACTORS SHALL NOTIFY THE DESIGN ENGINEER TO MODIFY CONSTRUCTION DOCUMENTS.

MARK HERRMANN, PE  
 PROFESSIONAL ENGINEER  
 N.J. LIC. NO. 48668

*Signature*  
 SIGNATURE 12/24/2014 DATE  
 CLIENT

MARINA DISTRICT  
 DEVELOPMENT  
 COMPANY, LLC

ONE BORGATA WAY  
 CITY OF ATLANTIC CITY, ATLANTIC COUNTY, NJ  
 PROJECT

BORGATA CASINO  
 OUTDOOR EVENT AREA  
 BLOCK 576  
 LOTS 1.05, 1.07, 1.08, 1.10 & 1.12

ONE BORGATA WAY  
 CITY OF ATLANTIC CITY, ATLANTIC COUNTY, NJ

SHEET TITLE  
**SOIL EROSION  
 AND SEDIMENT  
 CONTROL NOTES  
 AND DETAILS**

JOB NO.: 02265.0063  
 DATE: 12/24/2014  
 DRAWN: KDR  
 CHECK: MH  
 SCALE: AS SHOWN  
 BINDING ORDER:  
 SHEET OF  
 SHEET NO.

**C-08**